
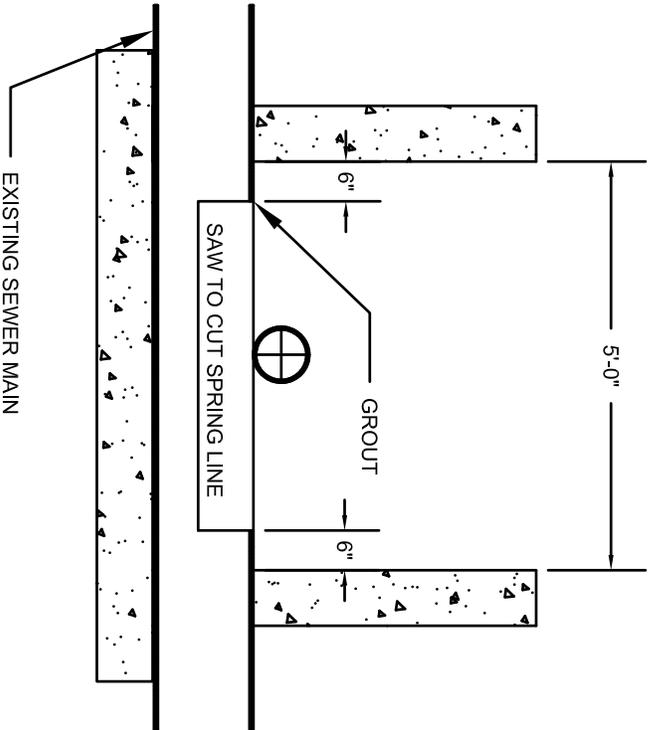


- NOTES:**
1. FLOW SHALL BE MAINTAINED DURING CONSTRUCTION.
 2. THIS DETAIL TO BE USED WHEN A 6" OR LARGER LATERAL NECESSITATES CONSTRUCTION OF A NEW MANHOLE.
 3. THE CONTRACTOR SHALL PROVIDE A MINIMUM 9" COMPACTED #67 STONE BASE.
 4. FOR USE ON DIP, CONCRETE AND PVC ONLY. (NOT ALLOWED ON VCP)
 5. BASE TO BE POURED WITH #5 REINFORCING BARS IN A PATTERN.

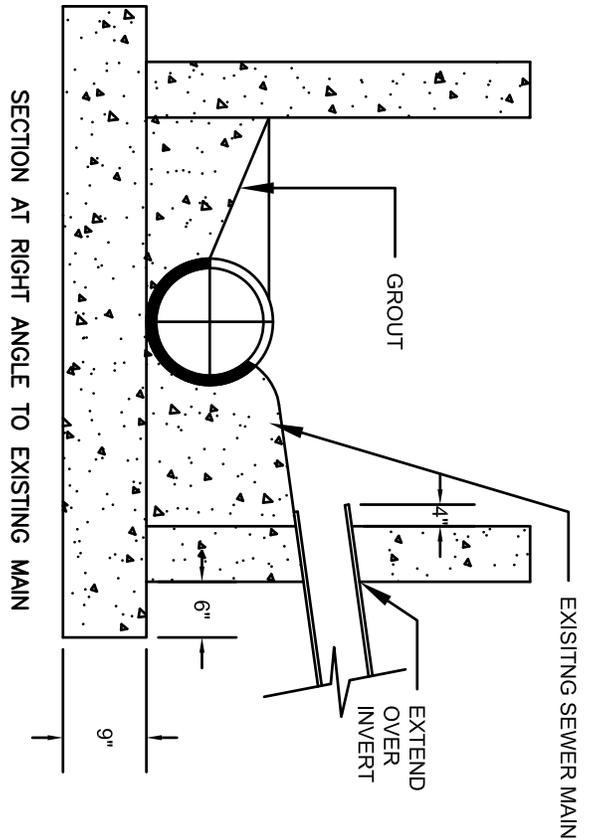

SECTION ALONG CENTRELINE OF EXISTING MAIN