

(PAVED AREAS)
12" THICKNESS SF 9.5A
(OR B) BASE COURSE
MAY BE USED OR 2' X 2'
X6" CONCRETE PAD
UNDER SURFACE COURSE

SCREW TYPE CAST
IRON VALVE BOX


NOTE TO CONTRACTOR:
VALVE BOX SHOULD NOT
CONTACT MAIN OR VALVE.

(UNPAVED AREAS)
CONCRETE ENCASEMENT
AT 3000 P.S.I.

NOTES:

1. ONLY MANUFACTURED VALVE BOX EXTENSIONS SHALL BE ALLOWED.
2. VALVE OPERATING NUT MUST BE EXTENDED SO THAT THE DEPTH IS NO GREATER THAN 5' (ft.) FROM THE SURFACE USING A MANUFACTURER APPROVED EXTENSION KIT.
3. PRECAST CONCRETE ENCASEMENT IS ALLOWED OUTSIDE OF PAVED AREAS.
3. WHEN VALVE IS ADJACENT TO TEE OR BEND, ANCHOR VALVE TO TEE OR BEND WITH TWO (2) 3/4" ALL THREADED RODS.

SECTION VIEW

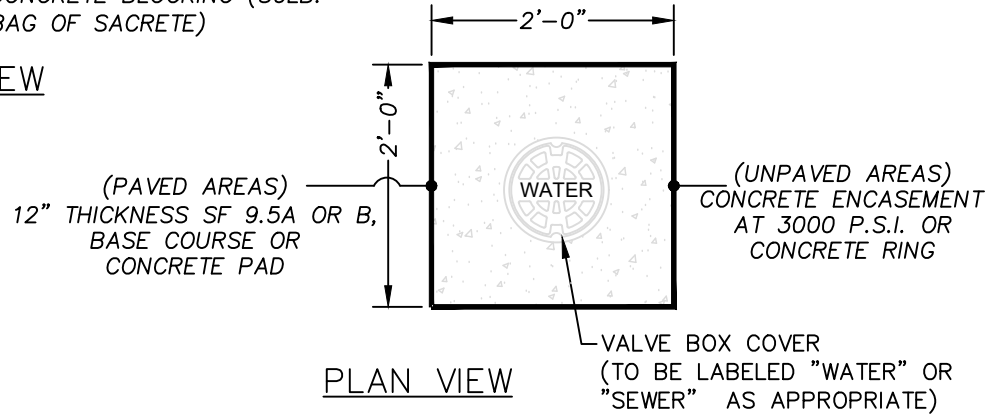

PLAN VIEW